

WWTP – EFFLUENT MODIFICATIONS

The **WASTEWATER TREATMENT PLANT – EFFLUENT MODIFICATIONS** address the conditions of Consent Order 13-018W, by dividing the 22 acre effluent holding pond into three cells and modifying the acid feed system.

COST

Design	\$200,000
Construction	\$1,500,000

FUNDING City of Georgetown


SCHEDULE

Select Designer	25 June 2013
Advertise for Bids	TBD
Open Bids	TBD
Award Bids	TBD
Start Construction	TBD
Substantial Completion	TBD

DESIGN Jacobs Engineering

CONSTRUCTION TBD

PARTNERS TBD

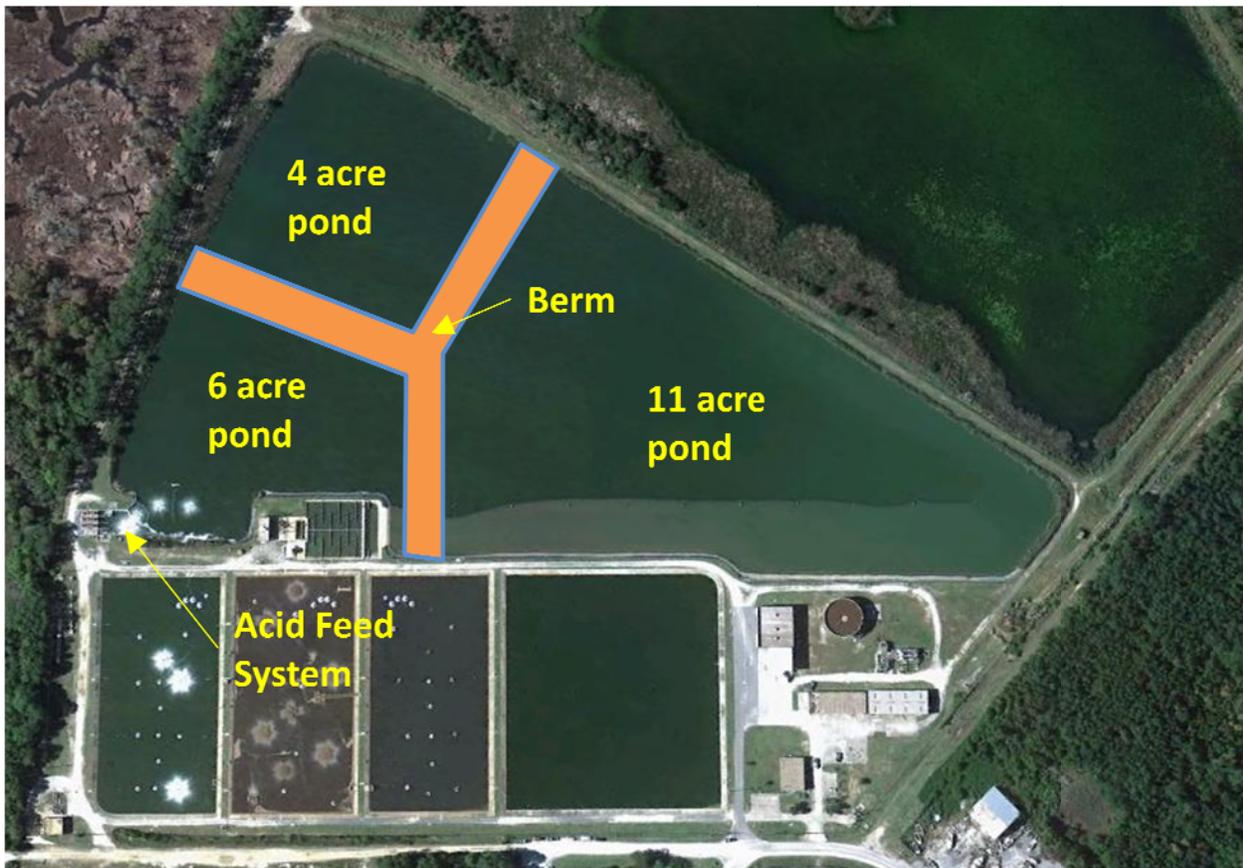

Public Works Division
125 N Kaminski St
Georgetown, SC 29440
(843)545-4700

Public Services Department
PO Box 939
Georgetown, SC 29442

Water Utilities Division
2377 Anthuan Maybank Dr
Georgetown, SC 29440
(843) 545-4500